


# POWER CONTROLLER- Assembly STEP - 3

## ASSEMBLY SEQUENCE

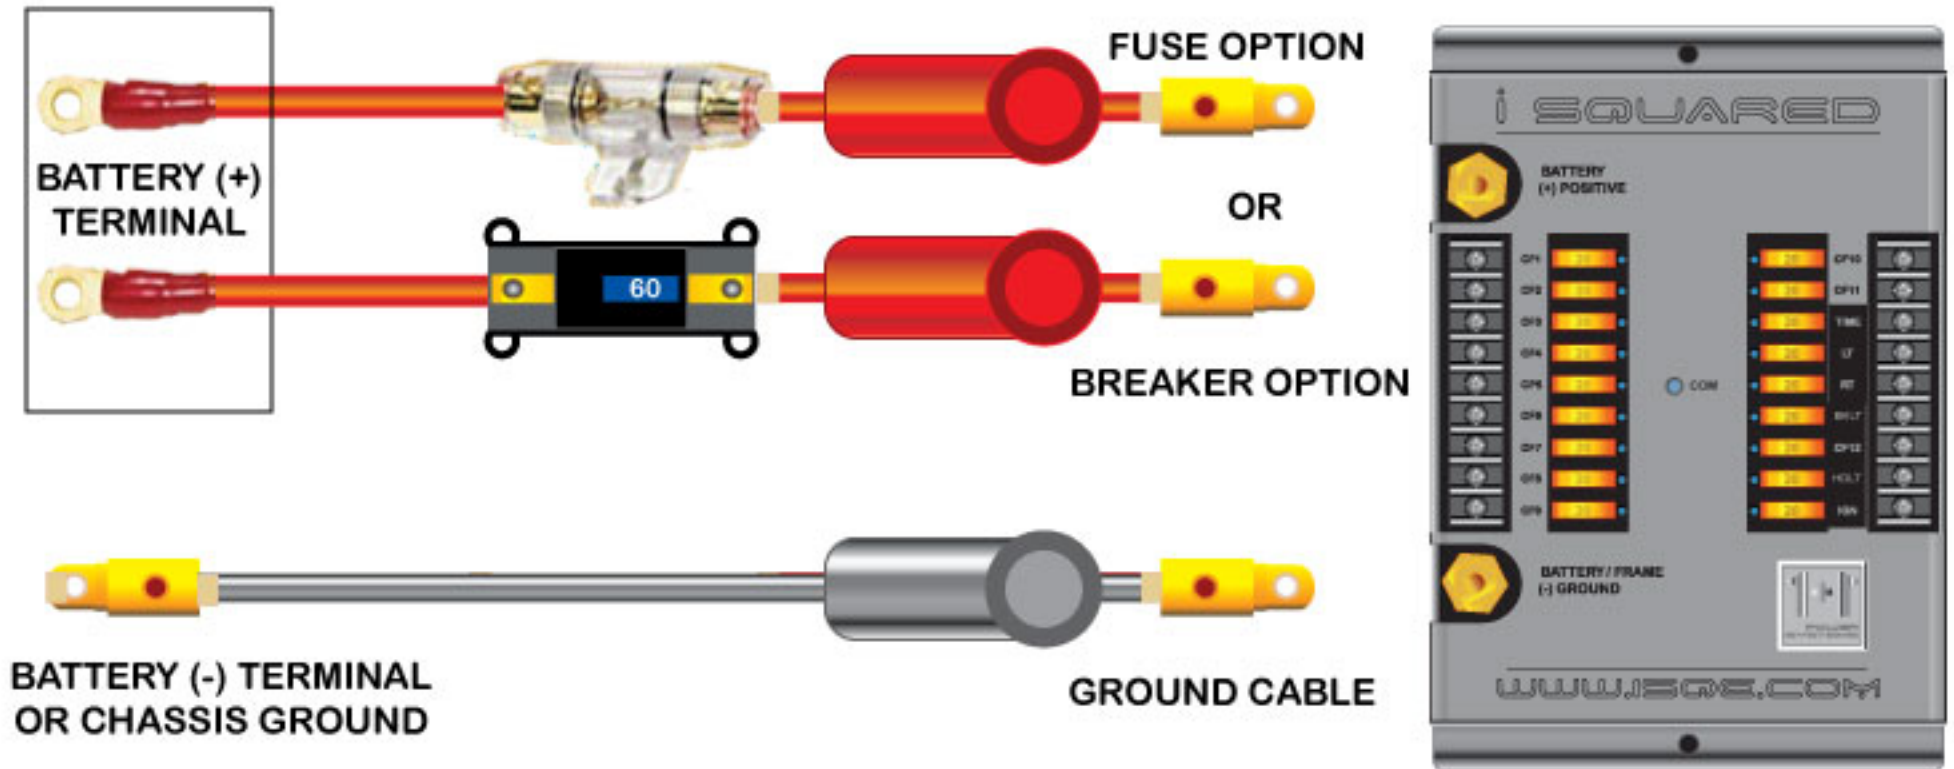

\* ASSEMBLE POWER CONTROLLER AS SHOWN WITH BREAKER OR FUSE OPTION

\* INSULATING BOOTS **MUST** BE USED ON MAIN POWER TERMINALS

\* DO NOT OVERTIGHTEN SET-SCREWS IN RING TERMINALS